



Northumberland National Park  
 Authority  
 Planning Department  
 Received

16 OCT 2014

All measurements  
 in mm unless  
 stated

9664

Concrete must be cast  
 at least 2 weeks prior  
 to installation. (2 layers  
 of re-inforcement  
 recommended. Use either  
 6mm bar in 100 x 100mm  
 mesh or re-bar 20mm  
 wired to j-bolts)

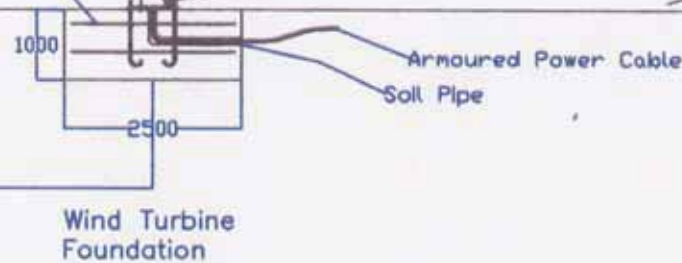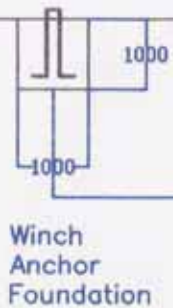

ZONE	REV	DESCRIPTION	REVISIONS	DATE	APPROVED	PREPARED BY BR	CHECKED BY
-	-	-	-	-	-		
-	-	-	-	-	-		
-	-	-	-	-	-		

PSOM NO.	DWG NO. 6000 FO 006 rev 3.dwg	REV
----------	----------------------------------	-----



© Proven Engineering Products Ltd, Wanshead Park,  
 Stewarton, Ayrshire, KA3 9LH, UK, Tel +44 1560 485 570  
 info@provenenergy.com All rights reserved

Proven WT8000 Turbine with TM800 Self Supporting  
 Tilt Up Tower (Side Elev)