



Northumberland National Park
19 MAY 2016
RECEIVED

THIS FORM IS FOR USE BY ELECTRICITY NETWORK OPERATORS TO ADVISE LOCAL PLANNING AUTHORITIES OF PROPOSED WORKS TO BE UNDERTAKEN WITHIN THEIR DESIGNATED AREA THAT ARE CONSIDERED TO BE EXEMPTED UNDER THE OVERHEAD LINES (EXEMPTION) (ENGLAND AND WALES) REGULATIONS 2009. LOCAL AUTHORITIES HAVE THE RIGHT TO INVOKE THE FULL SECTION 37 PROCESS UNDER THE ELECTRICITY ACT 1989 SHOULD IT BE CONSIDERED NECESSARY.

Details of Applicant	
Name:	Northern Powergrid (NorthEast) Limited
Contact Person:	IRENE ANDERSON (Wayleave Officer)
Address:	NEW YORK ROAD, SHIREMOOR, NEWCASTLE UPON TYNE NE27 0LP
Telephone No:	07885 376178
Applicants Ref:	IA/ENQ 5323591
Date:	18/05/2016

**Electricity Act 1989: Overhead Lines (Exemption)(England and Wales)
Regulations 2009**

Is to undertake the following work that is considered to be exempted from the Electricity Act 1989 by falling within the Overhead Lines (Exemption)(England and Wales) Regulations 2009:

REINFORCE THE BIRKS LOW VOLTAGE NETWORK TARSET HEXHAM NORTHUMBERLAND


Particulars of proposed works:

*In order to maintain/improve the security of electricity supplies Northern Powergrid propose to replace the existing wood poles in the same location and change 3 spans of the existing low voltage overhead conductors to Aerial Bunched Conductor (ABC) configuration at the The Birks Tarsset. the existing overhead line is shown in red on the attached plans.
The works are to be carried out under the terms and conditions of the above Act.
Please inform me of any comments with regards to this work within the next 21 days.*

The Council/Authority is requested to indicate that it has no objection to the work being carried out by returning two copies of this Form with the Certificate completed & signed.

Yours faithfully,

For and on behalf of the Applicant

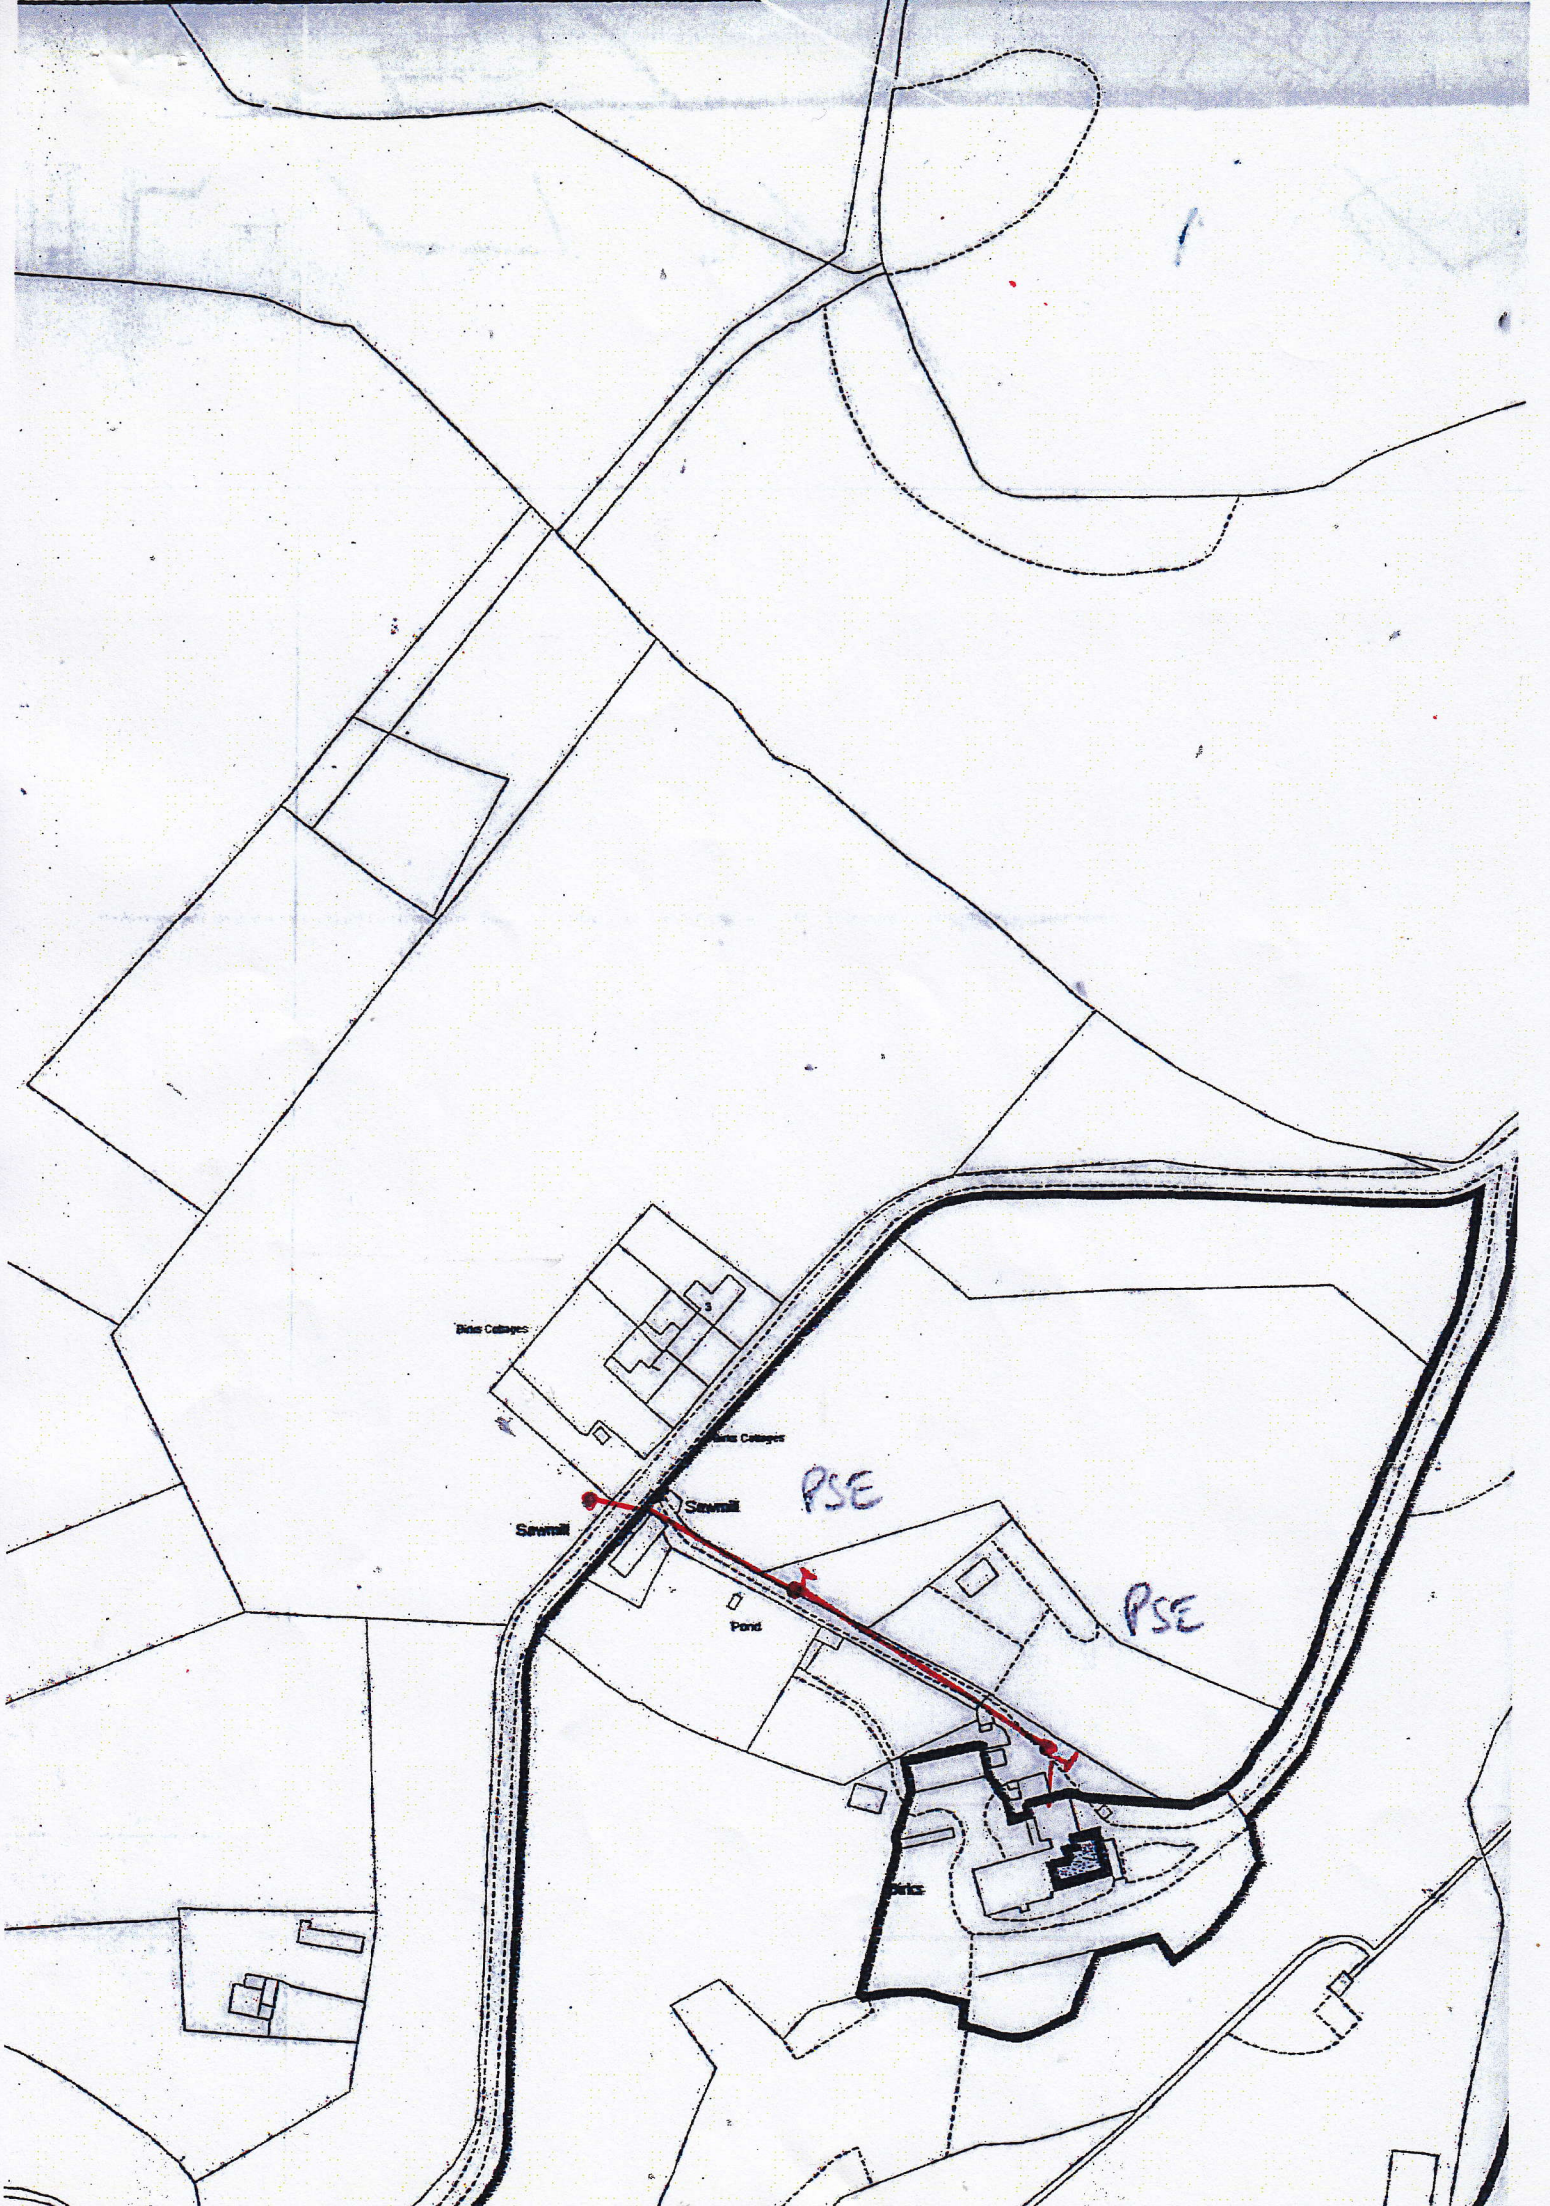

Bios Cellar

Bios Cellar

Sawmill

Sawmill

Pond

PSE

PSE

Price