


KEY

- EXISTING & OVERHEAD LINE
- OVERHEAD LINE + Poles to REMOVE
- NEW OVERHEAD LINE
- NEW STAY WARE
- NEW 'H' POLE + STAYS

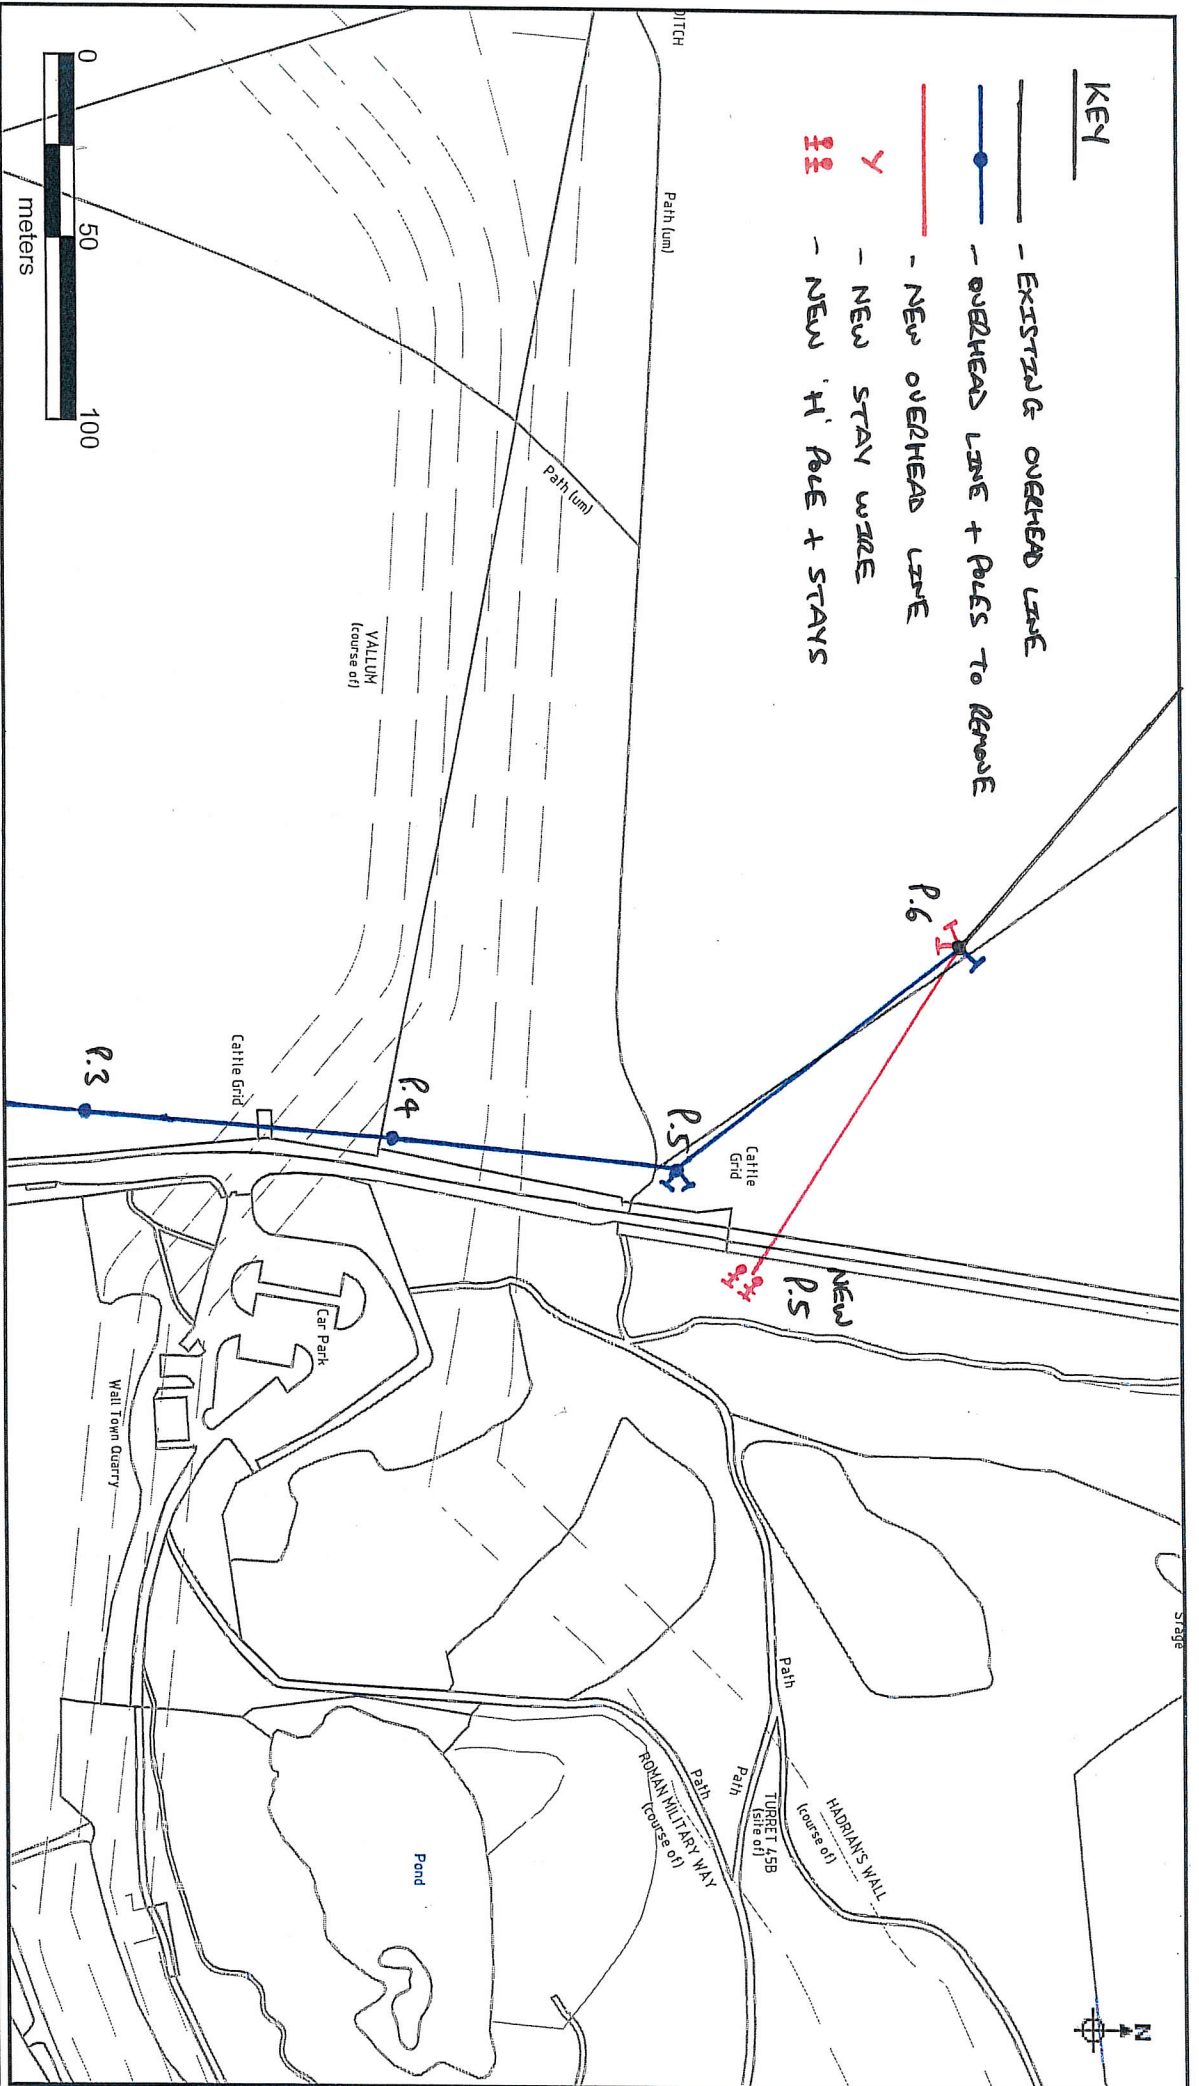

PLAN A

Call Centre Phone Numbers: If the area is located in: North East call 0800 668977, Yorkshire or North Lines call 0900 375675.

Northern Powergrid Holdings Company
 The position of our equipment is shown on the plan as accurately as possible, it may have changed since the plan was produced. Therefore the position of our equipment and those services which may be shown should be established on site. Electricity cables not owned by Northern Powergrid Holdings Company may be laid in this area and may not be shown on this plan. Where private cables are shown, the information should not be regarded as accurate and should be used for guidance purposes only. In all cases, accurate information should be obtained from the owner of such cables prior to the commencement of work on site.

References should be made to HSE Guidance, 'HS(G)47 Avoiding Danger from Underground Services' and GSS Avoidance of Danger from Overhead Power Lines.

Reproduced from an Extract with the Ordnance Survey map by Northern Powergrid Holdings Company by permission of Ordnance Survey of the Controller of Her Majesty's Stationary Office, Crown (c) Copyright (Northern Powergrid Holdings Company, EL100017231 and EL100017231)

Version 1.0 13th Dec 2017


Date Printed: 11-Apr-2018
 Scale: 1: 2000

OS Grid Reference: NY6675466023

Printed By: Ross Anderson

Title: RAD/173699



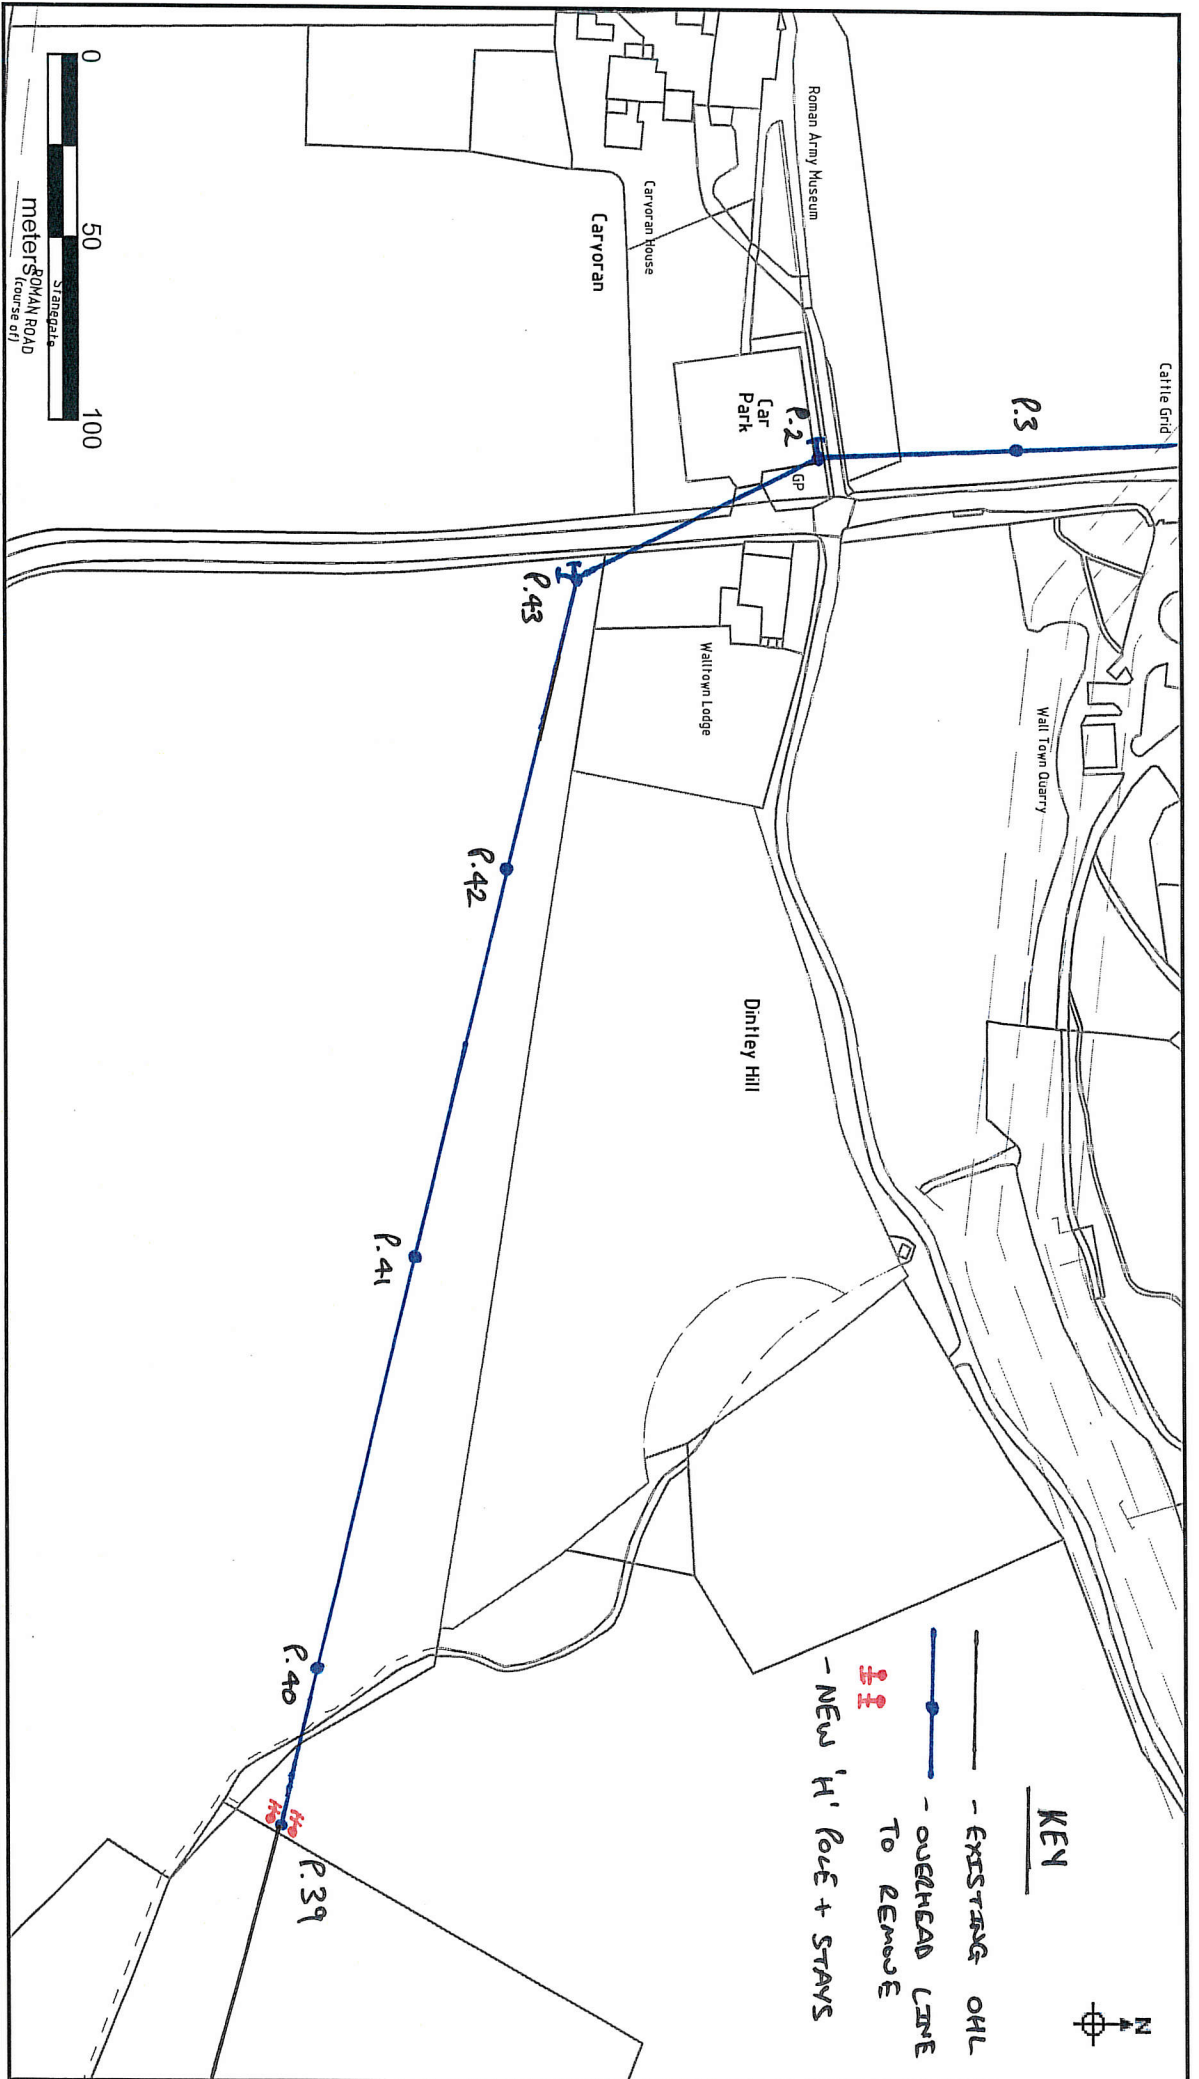

Call Centre Phone Numbers: If the area is located in: North East call 0800 666977, Yorkshire or North Lines call 0800 375675.

Northern Powergrid Holdings Company

The position of our equipment, as shown on this plan, is shown as accurately as possible. It may have changed since the plan was prepared. The position of our equipment, as shown on this plan, is shown as accurately as possible. It may have changed since the plan was prepared. The position of our equipment, as shown on this plan, is shown as accurately as possible. It may have changed since the plan was prepared.

Reference should be made to HSE Guidance, HSG67 'Avoiding Danger from Underground Services' and G58 'Avoidance of Danger from Overhead Power Lines'.

Reproduced from or based upon the Ordnance Survey map by Northern Powergrid Holdings Company by permission of Ordnance Survey of the Controller of Her Majesty's Stationary Office. Crown Copyright (Northern Powergrid Holdings Company; E110001751 and E110001752)

PLAN B

OS Grid Reference: NY6694065767

Printed By: Ross Anderson

Title: RA/DI/73699



Date Printed: 11-Apr-2018 Scale: 1:2000