

Call Centre Phone Numbers: If the area is located in: North East call 0800 668877, Yorkshire or North Lincs call 0800 375675.

Northern Powergrid Holdings Company

The position of our equipment is shown on the plan as accurately as possible, it may have changed since the plan was produced. Therefore the position of our equipment and those services which may not be shown should be established on site. Electrically cables not owned by Northern Powergrid Holdings Company may be laid in this area and may not be shown on this plan. Where private cables are shown, the information should not be regarded as accurate and should be used for guidance purposes only. In all cases, accurate information should be obtained from the owner of such cables prior to the commencement of work on site.

Reference should be made to HSE Guidance, HS(G)47 'Avoiding Danger from Underground Services' and GS6 'Avoidance of Danger from Overhead Power Lines'.

Reproduced from or based upon the Ordnance Survey map by Northern Powergrid Holdings Company by permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationary Office. Crown (c) Copyright (Northern Powergrid Holdings Company, EL100017931 and EL100036857).

PLAN A

OS Grid Reference: NY6675466023

Printed By: Ross Anderson


Title:

RA/DI73699



Date Printed: 11-Apr-2018

Scale: 1:2000

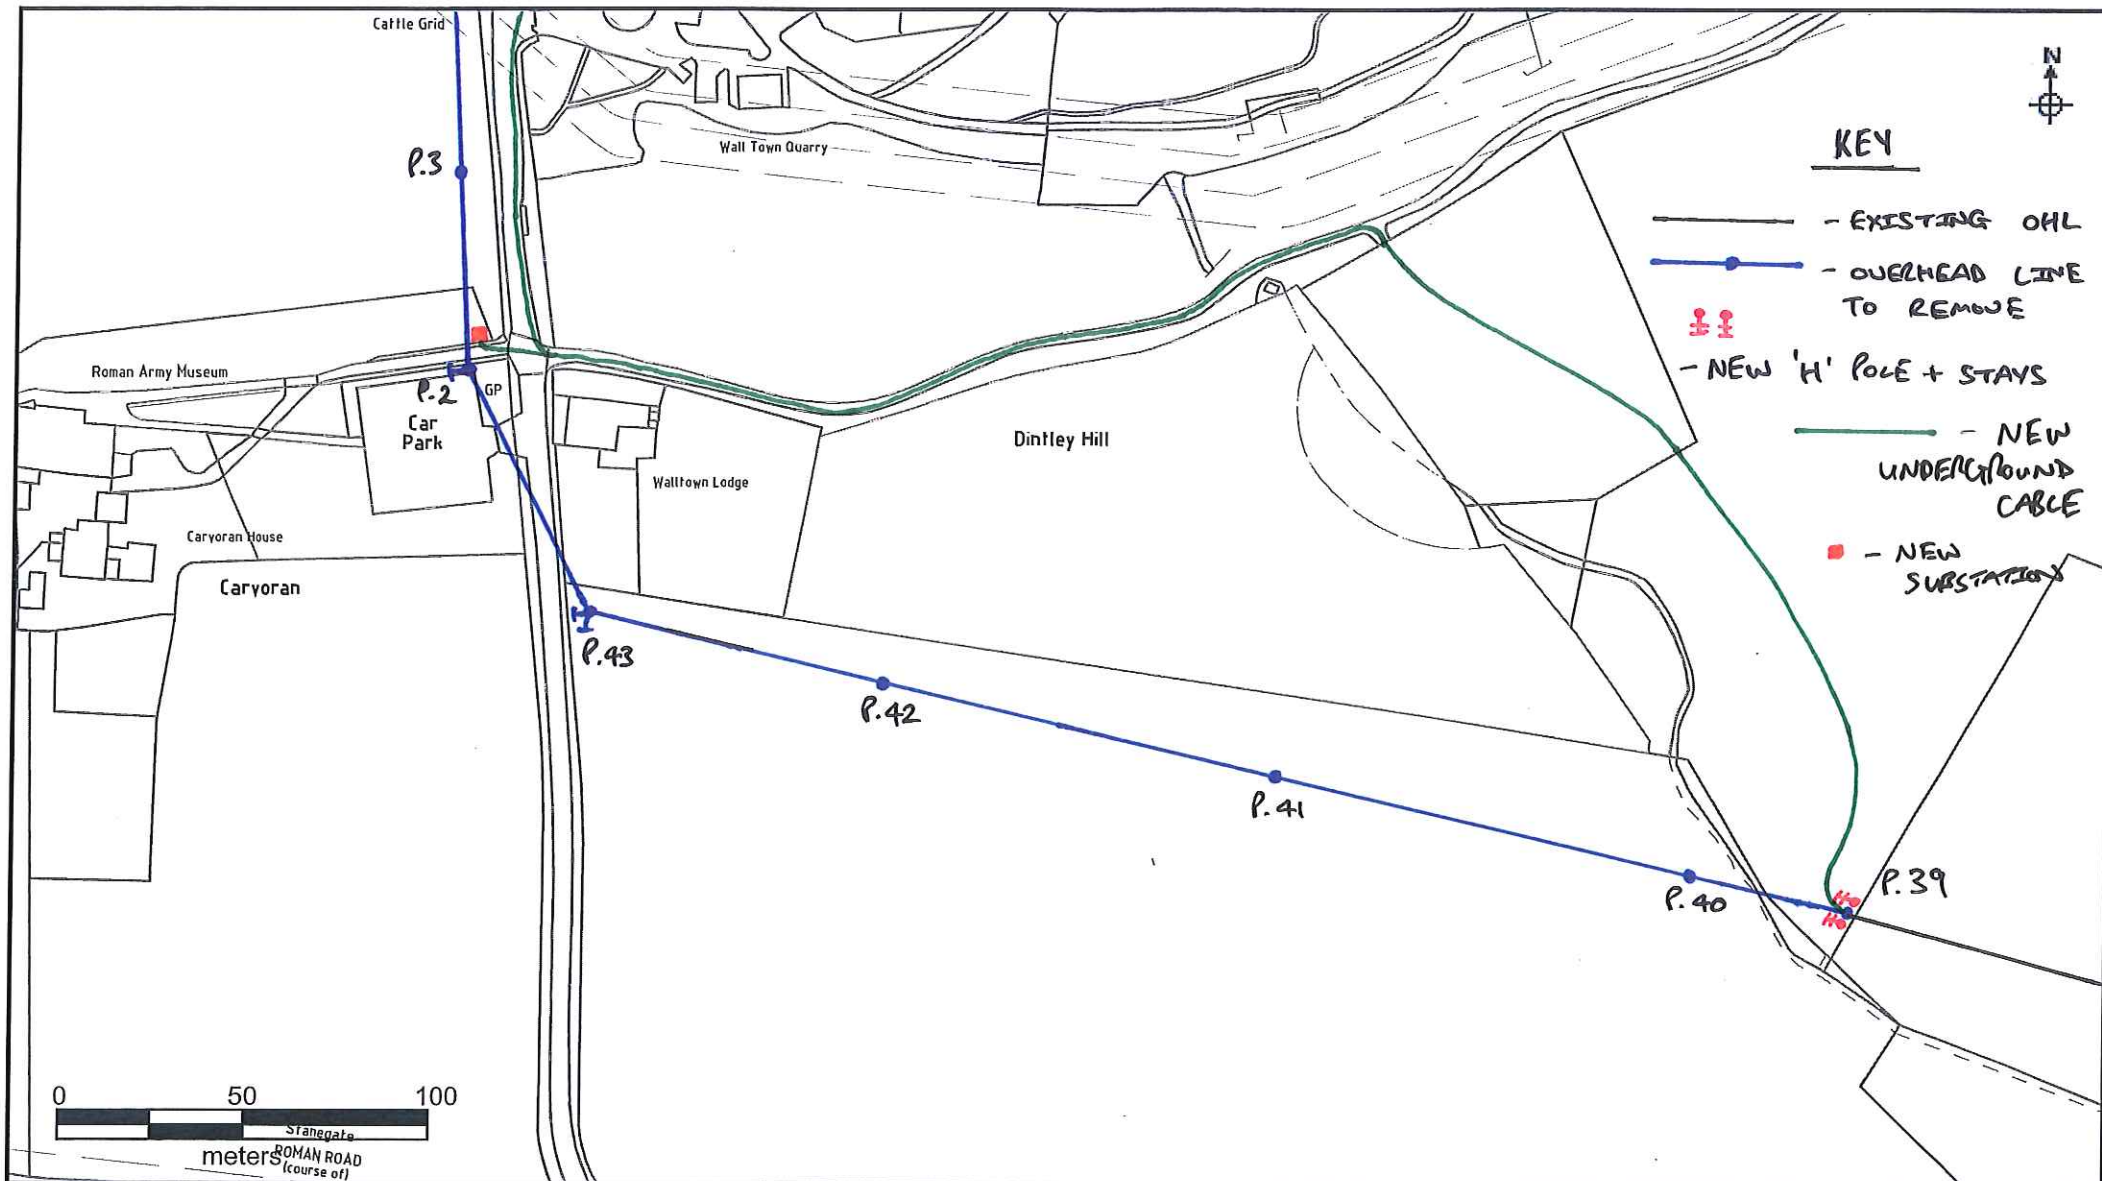

Call Centre Phone Numbers: If the area is located in: North East call 0800 688877, Yorkshire or North Lincs call 0800 375675.

Northern Powergrid Holdings Company

The position of our equipment is shown on the plan as accurately as possible, it may have changed since the plan was produced. Therefore the position of our equipment and those services which may not be shown should be established on site. Electricity cables not owned by Northern Powergrid Holdings Company may be laid in this area and may not be shown on this plan. Where private cables are shown, the Information should not be regarded as accurate and should be used for guidance purposes only. In all cases, accurate information should be obtained from the owner of such cables prior to the commencement of work on site.

Reference should be made to HSE Guidance, HS(G)47 'Avoiding Danger from Underground Services' and GS6 'Avoidance of Danger from Overhead Power Lines'.

Reproduced from or based upon the Ordnance Survey map by Northern Powergrid Holdings Company by permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationary Office. Crown (c) Copyright (Northern Powergrid Holdings Company, EL100017931 and EL100036857).

PLAN B

Date Printed: 11-Apr-2018

Scale: 1: 2000

OS Grid Reference: NY6694065767

Printed By: Ross.Anderson

Title:

RA/DI73699

