


CLASS S PIPE BEDDING AND SECTION DETAILS

Class S Bedding Details

1. This dimension is to be $\frac{1}{6} Bc$ or 150 whichever is the greater, or in the case of rock or where irregular hard spots may occur, the dimension is to be $\frac{1}{4} Bc$ or 200 whichever is the greater but in any case not less than 50 under the sockets.
2. Selected backfill is to be free from vegetable matter, rubbish and frozen soil, and is to exclude stones and lumps retained on a 40mm sieve, hand compacted in layers not exceeding 150mm.
3. Where pipelines run under paved/trafficked areas the trench backfill is to be 150mm thk compacted layers of Type 2 granular sub base to DoT Clause 804 to the underside of the pavement construction.

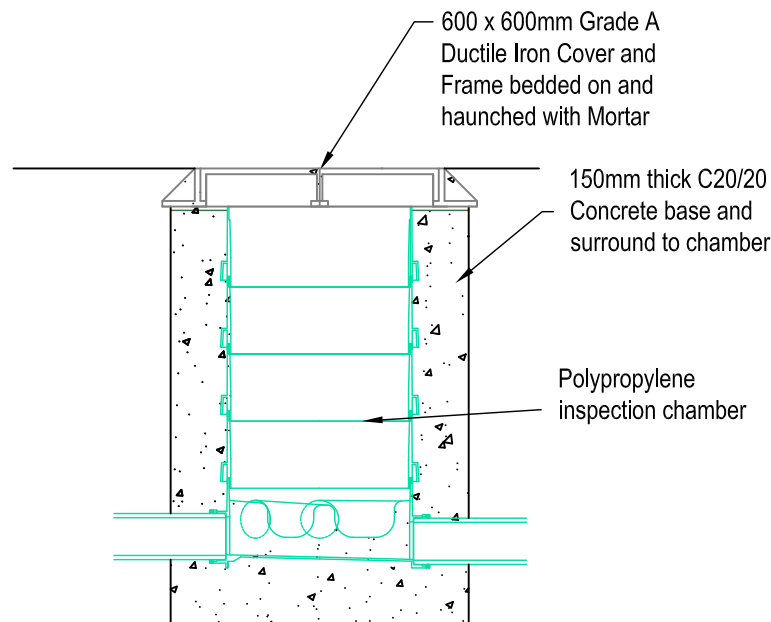

450mm Dia. PLASTIC INSPECTION CHAMBER LOCATED IN ACCESS ROAD

Client
HUTCHINSON ENVIRONMENTAL SOLUTIONS LTD
 Project Title
BELLINGHAM CARAVAN SITE

Drawing Title
DRAINAGE CONSTRUCTION DETAILS

Project No. 2019/01	Dwg. No. N01	Drawn By DW	Checked PS
Date. 12/03/2019	Scale 1:20	Revision 0	Sheet Size A4

14 Brenkley Way
 Blezard Business Park
 Seaton Burn
 Newcastle
 NE13 6DS
office@northpointconsulting.co.uk
 TEL - 0191 217 1952
 FAX - 0191 217 1612

